


# FIRMWARE UPDATE INSTRUCTIONS - MODEL TMS3000

- 1 Turn OFF power. Remove processor board from console and place on a solid, flat surface. Remove chips from "U4" and "U5" sockets using a PLCC extractor tool.

## ⚠ WARNING


**TURN OFF POWER TO CONSOLE BEFORE SERVICING.**

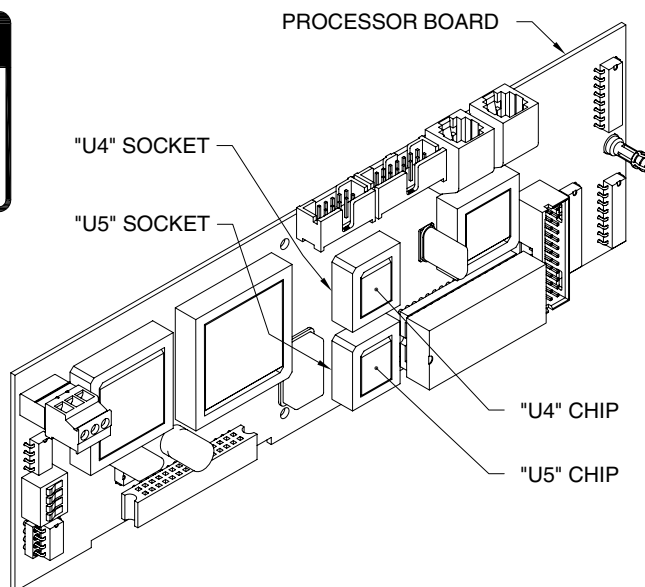

- 2 Install new firmware chips, noting orientation as shown below.

## ⚠ WARNING

**CHECK ORIENTATION BEFORE PRESSING CHIP INTO SOCKET TO PREVENT PERMANENT DAMAGE TO BOARD AND/OR DEVICE.**

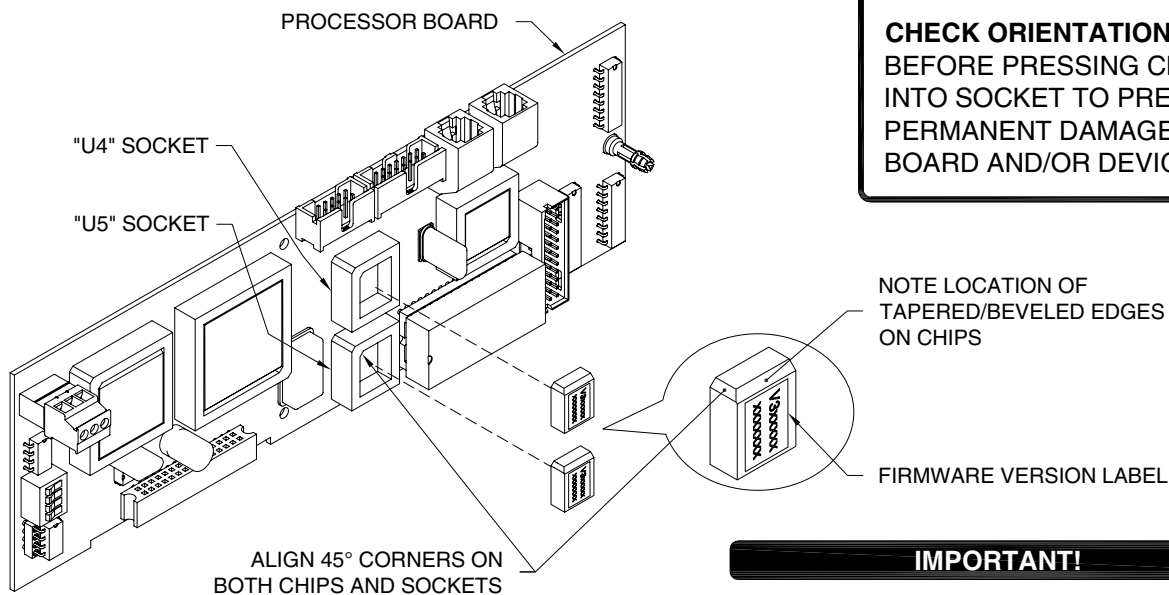

## IMPORTANT!

BOTH FIRMWARE CHIPS ARE IDENTICAL AND CAN BE INSTALLED IN EITHER "U4" OR "U5" SOCKETS.

PROCESSOR BOARDS UP TO **REV. P** ARE **COMPATIBLE** WITH FIRMWARE VERSIONS **V3x.99.xx**. CONSEQUENTLY, **REV. Q AND LATER** BOARDS ARE **NOT COMPATIBLE** WITH FIRMWARE VERSIONS **V3x.99.xx**. NOTE THAT V3x.00.xx AND V3x.01.xx WERE RELEASED AFTER V3x.99.xx.

Questions? Contact Technical Support at (800) 209-7858

**PNEUMERCATOR**  
Liquid Level Control Systems