


IMPORTANT! LC2000 AND TMS SERIES GROUND WIRING INSTRUCTIONS

PARTIAL VIEW OF A TYPICAL SERVICE PANEL

PARTIAL VIEW OF LC2000/TMS CONSOLE

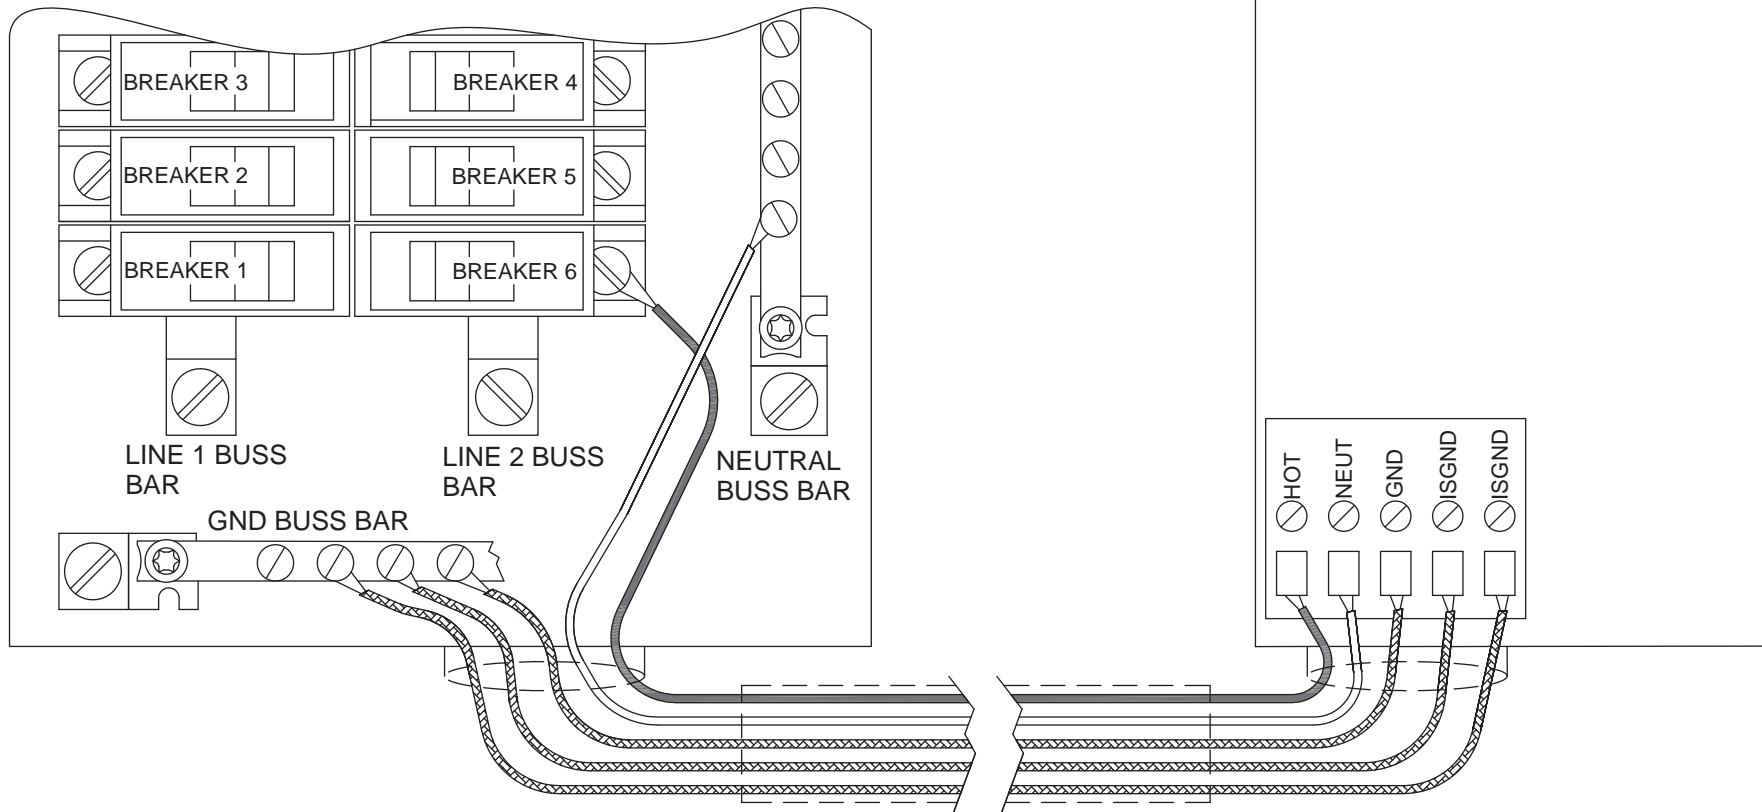

NOTE:

ALL GROUNDS MUST BE TERMINATED AT THE GND BUSS BAR IN THE SAME SERVICE PANEL AS LC2000 AND/OR TMS POWER. A GROUNDING ROD, COLDWATER PIPE OR OTHER CONNECTION SHOULD NOT BE USED.