

# IMPORTANT! TMS1000\*, TMS4000M\* AND UPS3 SERIES GROUND WIRING INSTRUCTIONS

\* SEE BULLETIN 172 FOR ALL OTHER TMS SERIES.

PARTIAL VIEW OF A TYPICAL SERVICE PANEL


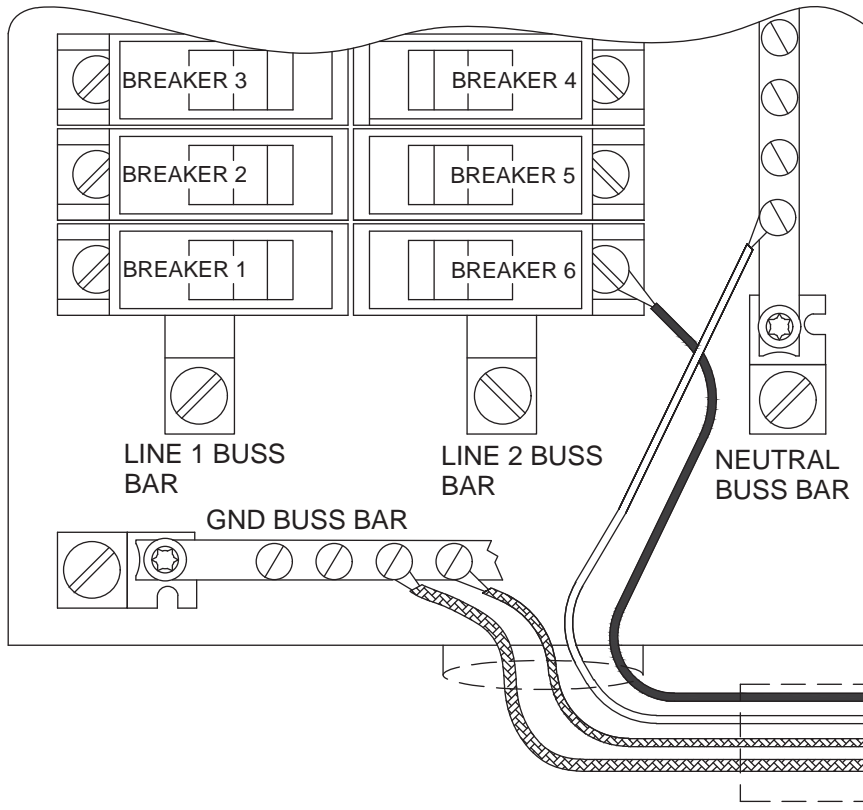


ILLUSTRATION OF TMS1000\*/TMS4000M\*/UPS3 CONSOLE

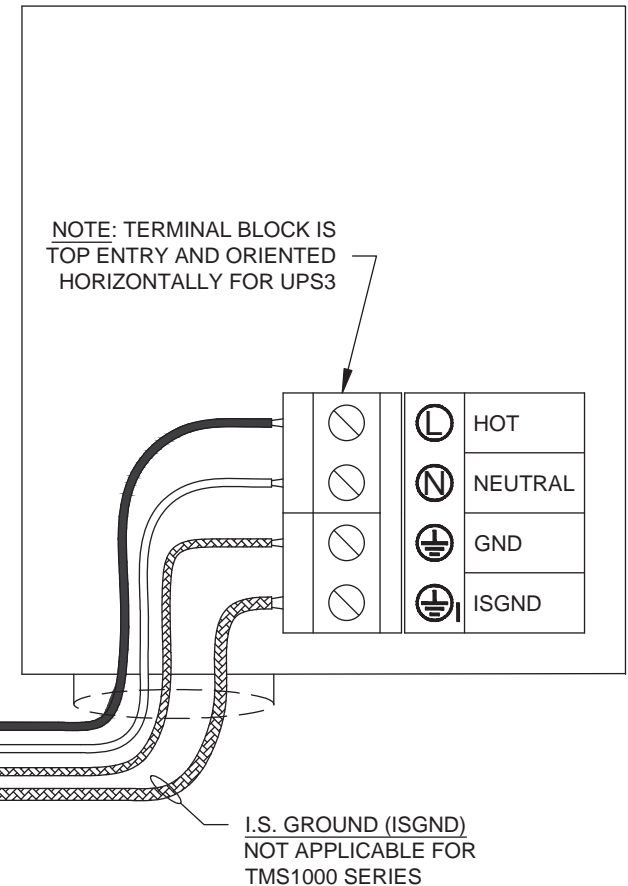

**NOTE:**

ALL GROUNDS MUST BE TERMINATED AT THE GND BUSS BAR IN THE SAME SERVICE PANEL AS POWER FOR SPECIFIED CONSOLES. A GROUNDING ROD, COLDWATER PIPE OR OTHER CONNECTION SHOULD NOT BE USED.